


System BK-N

8. Fire protection measures

8.1 Cables / cable bundles / cable trays

Cable bundles with a diameter of ≤ 100 mm may be installed unopened in the seal. It is not necessary to fill the gussets if the bundles consist of parallel-running cables that are tightly packed, tied, stitched or welded together.
(Outer diameter of the individual cable: ≤ 21 mm).

Design for wall and floor penetration sealing system

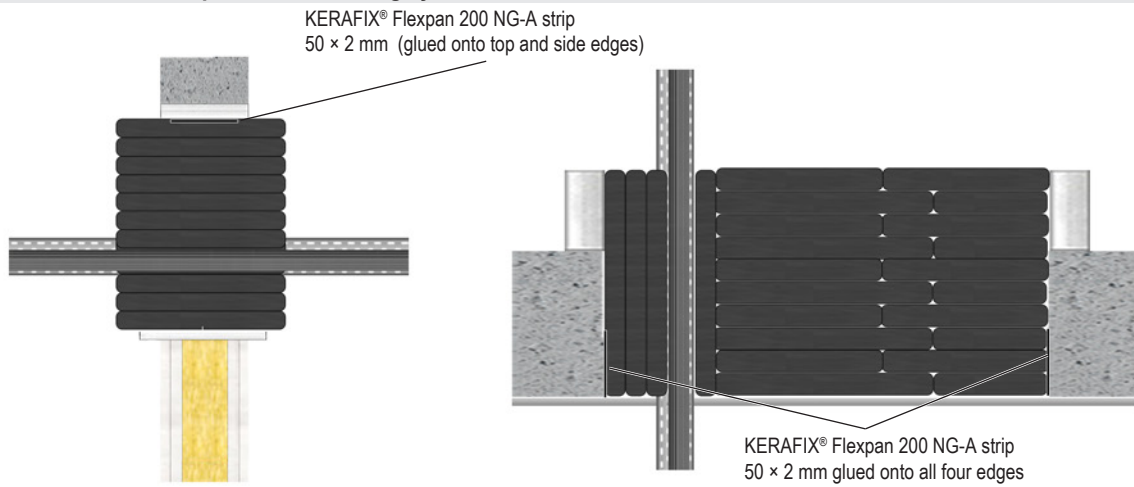

For thicknesses and design variants, see page 5.

| | Dimensions [mm] |
|-----------------------------------|---|
| Sheathed cable types | ≤ 80 |
| Non-sheathed cable types | ≤ 24 |
| Cable bundles | cable $\varnothing \leq 21$, bundle $\varnothing \leq 100$ |
| Conduits made of steel or plastic | ≤ 16 |