


# Brandbare leidingen FLAMRO® KSL OSI (one-sided installation) systeem Variant N-II A manchet

Steenwol brandschot / Flexible Elastomeric Foam (FEF) isolatie /  
Brandmanchet

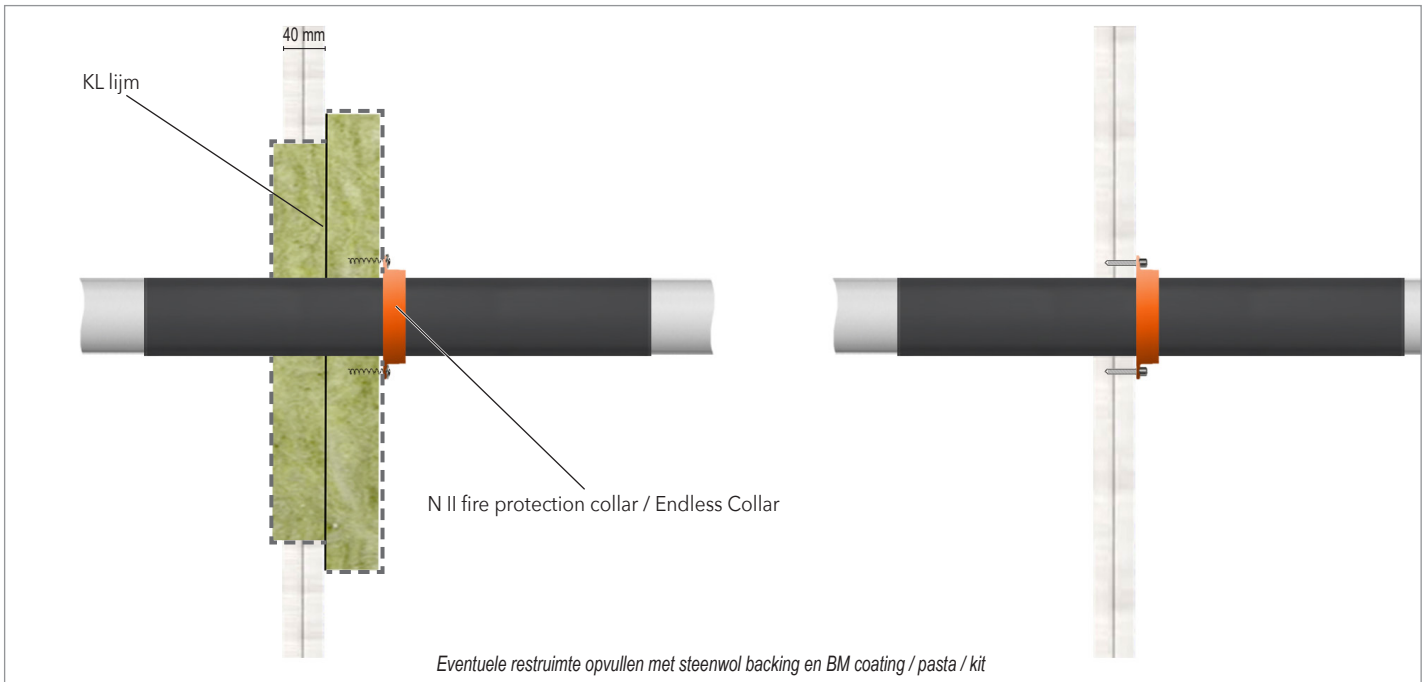

Z19.53-2369

Shaft wall							
Pipe material/Type	Pipe outer Ø (mm)	Pipe wall thickness (mm)	Insulation	Insulation thickness T (mm)	Insulation length	N II A Collar installation	Fire resistance class
Plastic pipes	≤ 110	1,8 - 15,2	Flexible Elastomeric Foam (FEF)	9 - 50	CS	One-sided	EI = 90 U/C
<b>First support</b>	≥ 100 - ≤ 600 mm		<b>Max sparing</b>	800 x 600 mm			

Deze handleiding dient als ondersteuning voor een juiste montage.

Voor uitgebreide montagedetails, zie *Installation Manual of classificatierapport*

Aan deze detailtekening kunnen geen rechten worden ontleend.

Bij afwijkende situaties raadpleeg onze technische support:

+31 10 72 71 044

[info@svt-products.nl](mailto:info@svt-products.nl)