


# Brandbare leidingen FLAMRO® KSL OSI (one-sided installation) systeem KSL-W Firewrap

## Steenwol brandschot / Firewrap

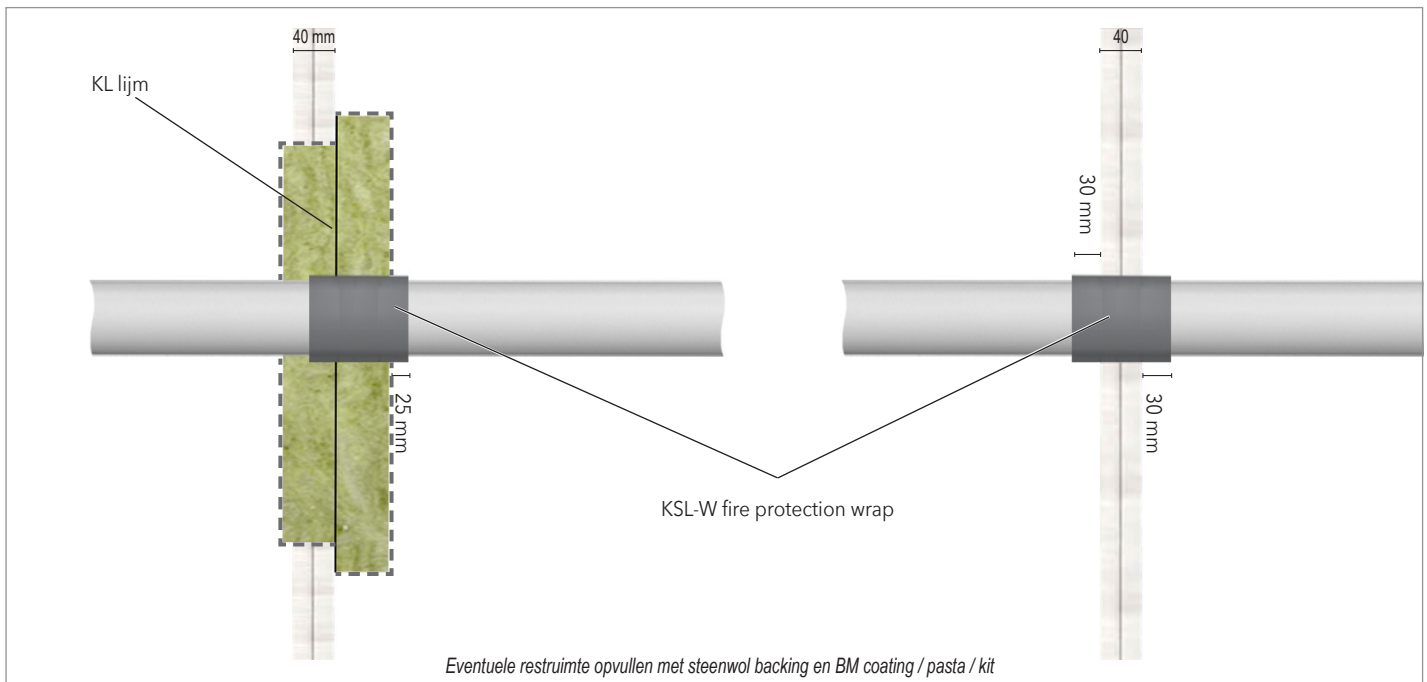

ETA-22/0052

Shaft wall										
Pipe material/Type		Pipe outer Ø (mm)	Pipe wall thickness (mm)	No. of layers	Insulation	KSL-W fire protection wrap				Fire resistance class
						Width (mm)	No. of wraps	Inside seal (mm)	Outside seal (mm)	
	Plastic pipes	≤ 50	1,8 - 15,2	1	None	100	1	75	25	EI = 120 U/U
		≤ 70		2						
		≤ 110		3						
	Multilayer pipes	≤ 50	10	1	None	100	1	75	25	EI = 120 U/C
		≤ 70		2						
		≤ 110		3						
<b>First support</b>	≥ 100 - ≤ 600 mm		<b>Max sparing</b>	800 x 600 mm						

Deze handleiding dient als ondersteuning voor een juiste montage.

Voor uitgebreide montagedetails, zie *Installation Manual of classificatierapport*

Aan deze detailtekening kunnen geen rechten worden ontleend.

Bij afwijkende situaties raadpleeg onze technische support:

+31 10 72 71 044

info@svt-products.nl