


Brandbare leidingen FLAMRO® BSB Stenenschot KSL-W Firewrap

Steenwol brandschot / Firewrap

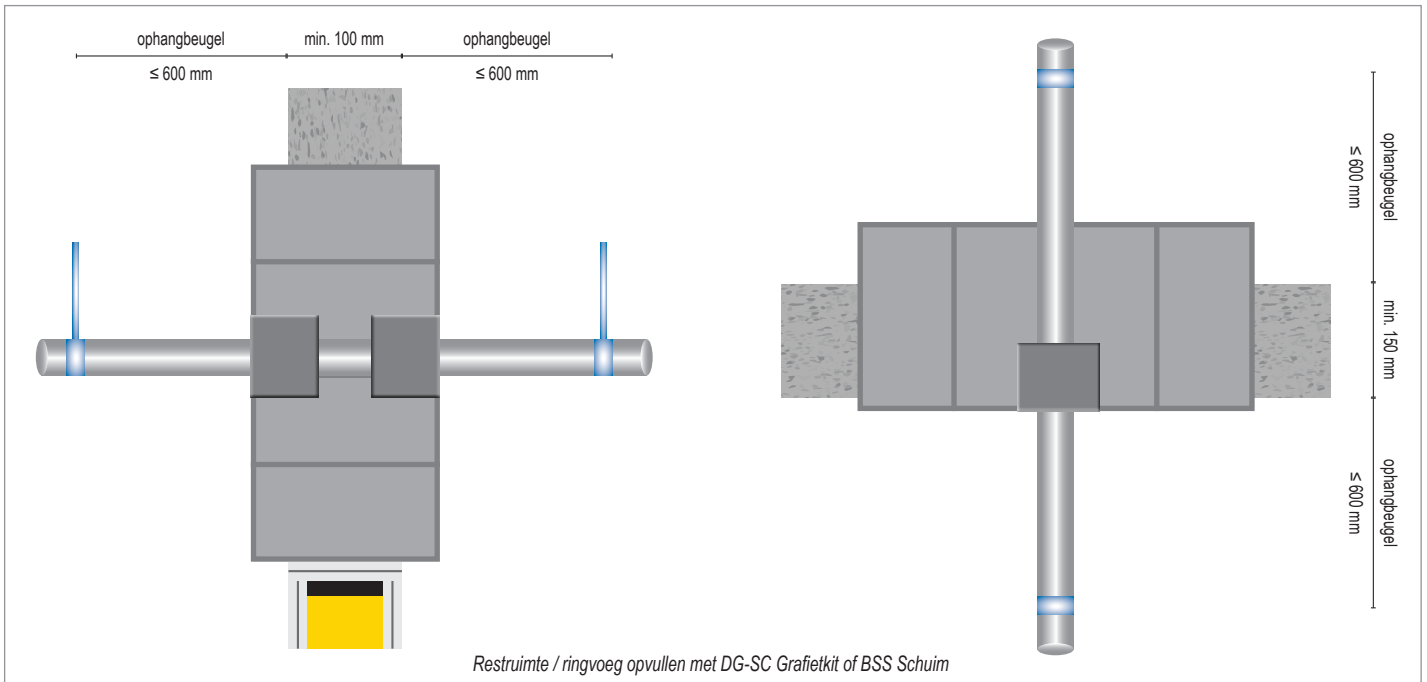

KB-Z-19-53-2608

Wall - Installation KSL-W on both sides											
Pipe material/Type		Pipe outer Ø (mm)	Pipe wall thickness (mm)	No. of layers	Insulation	Insulation thickness	KSL-W fire protection wrap				Fire resistance class
							Width (mm)	No. of wraps	Inside seal (mm)	Outside seal (mm)	
	Plastic pipes	≤ 50	1,8 - 15,2	-	None	-	50	2	50	0	EI = 90
		≤ 75		1							
		≤ 110		2							
	Multilayer pipes	≤ 50			FEF	13-25					EI = 90
Floor - Installation KSL-W on lower side											
	Plastic pipes	≤ 50	1,8 - 15,2	-	None	-	50	1	50	0	EI = 90
		≤ 75		1							
		≤ 110		2							
	Multilayer pipes	≤ 50			FEF	13-25					EI = 90
First support	≥ 100 - ≤ 600 mm		Max sparring	600 x 600 mm							

Deze handleiding dient als ondersteuning voor een juiste montage.

Voor uitgebreide montagedetails, zie *Installation Manual of classificatierapport*

Aan deze detailtekening kunnen geen rechten worden ontleend.

Bij afwijkende situaties raadpleeg onze technische support:

+31 10 72 71 044

info@svt-products.nl